
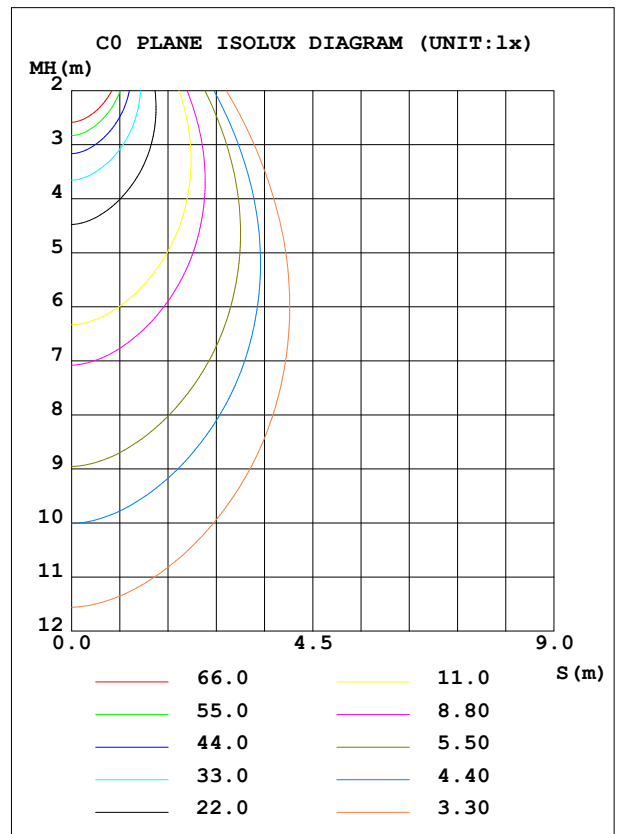


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.06V I:0.0543A P:7.2396W PF:0.6061 Freq:50.00Hz Lamp Flux:684.603x1 lm		
NAME: 4" Globe	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA			
MODEL		Imax (cd)	441.4	S/MH (C0/180)	0.97
NOMINAL POWER (W)	--	LOR (%)	100.0	S/MH (C90/270)	0.94
RATED VOLTAGE (V)	--	TOTAL FLUX (lm)	684.60	η UP, DN (C0-180)	1.9, 48.4
NOMINAL FLUX (lm)	684.603	CIE CLASS	DIRECT	η UP, DN (C180-360)	1.7, 48.0
LAMPS INSIDE	1	η up (%)	3.5	CIBSE SHR NOM	1.00
TEST VOLTAGE (V)	--	η down (%)	96.5	CIBSE SHR MAX	1.05

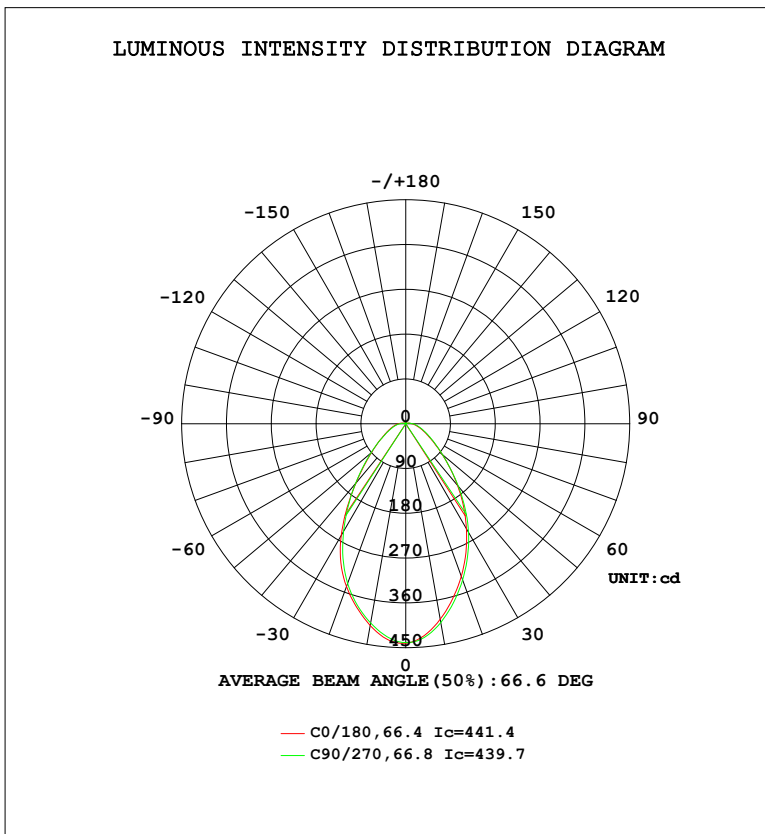

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	398.7	405.7	405.4	397.6	411.6	418.4	406.4	397.1	0- 10	40.23	40.23	5.88,5.88
20	326.2	336.2	333.9	324.0	348.1	367.3	341.5	321.7	10- 20	104.5	144.8	21.1,21.1
30	244.1	254.2	252.1	239.9	259.3	270.8	250.1	238.8	20- 30	135.7	280.4	41,41
40	162.3	166.8	164.7	153.3	156.2	158.6	157.4	159.2	30- 40	127.2	407.7	59.5,59.5
50	95.38	97.81	96.23	90.29	89.70	89.57	91.26	95.24	40- 50	95.10	502.8	73.4,73.4
60	56.00	58.36	58.19	55.77	53.91	52.77	52.96	54.55	50- 60	64.68	567.4	82.9,82.9
70	34.60	36.36	37.07	36.55	35.38	33.87	33.05	33.65	60- 70	43.80	611.2	89.3,89.3
80	21.44	22.71	23.60	23.77	23.39	21.85	20.80	21.01	70- 80	29.80	641.0	93.6,93.6
90	12.94	13.46	14.37	14.62	14.77	13.13	12.18	12.20	80- 90	19.28	660.3	96.5,96.5
100	7.207	7.359	8.015	8.189	8.527	7.185	6.449	6.431	90-100	11.20	671.5	98.1,98.1
110	3.776	1.621	1.471	2.535	4.368	2.038	1.121	2.010	100-110	5.295	676.8	98.9,98.9
120	2.270	0.9401	0.8668	0.8909	2.256	0.9109	0.8467	0.8357	110-120	1.802	678.6	99.1,99.1
130	2.101	1.494	1.276	1.368	1.988	1.400	1.203	1.298	120-130	1.240	679.9	99.3,99.3
140	2.349	2.020	1.712	1.949	2.238	1.828	1.608	1.734	130-140	1.337	681.2	99.5,99.5
150	2.552	2.300	2.134	2.306	2.434	2.149	2.030	2.090	140-150	1.306	682.5	99.7,99.7
160	2.677	2.536	2.468	2.543	2.626	2.432	2.366	2.408	150-160	1.097	683.6	99.9,99.9
170	2.805	2.742	2.720	2.710	2.805	2.671	2.658	2.650	160-170	0.7379	684.3	100,100
180	2.919	2.841	2.803	2.804	2.921	2.838	2.805	2.806	170-180	0.2642	684.6	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 459.56 lm

%lum = 67.1%

%lamp = 67.1%

Conical surface Flux(120deg): 567.44 lm


%lum = 82.9%

%lamp = 82.9%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

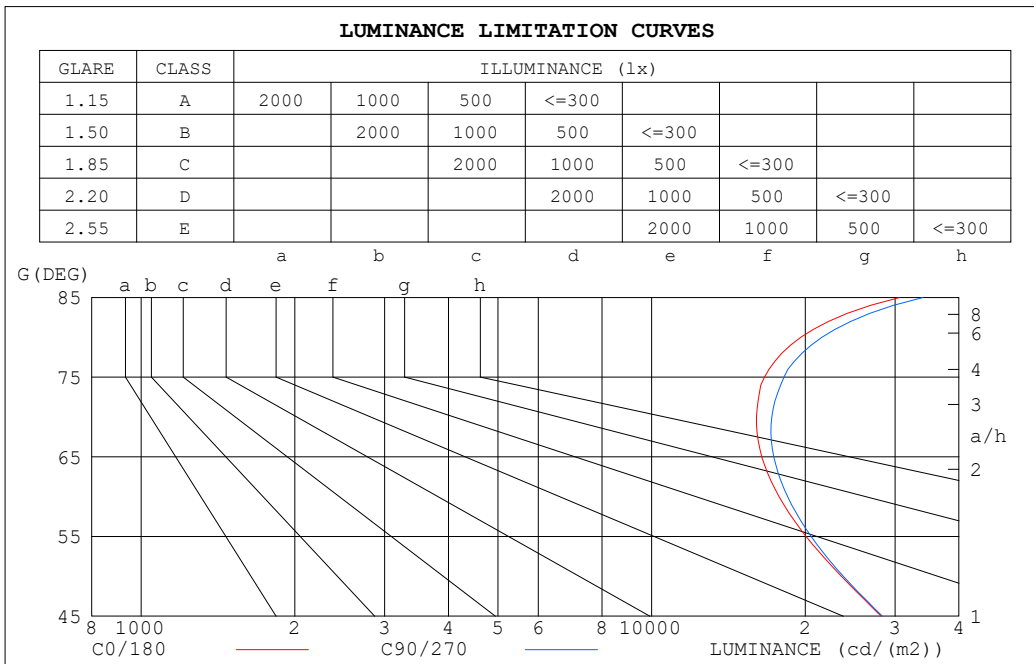


LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	30600	33987
80	19600	21572
75	16638	18178
70	16056	17205
65	16444	17357
60	17777	18474
55	20080	20544
50	23552	23764
45	28175	28333

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.18	1.18	1.18	1.15	1.15	1.15	1.09	1.09	1.09	1.04	1.04	1.04	.99	.99	.99	.96
1.0	1.05	1.01	.98	1.02	.99	.96	.97	.95	.92	.93	.91	.89	.89	.87	.85	.83
2.0	.94	.88	.83	.91	.86	.81	.87	.83	.79	.84	.80	.77	.80	.77	.75	.72
3.0	.84	.77	.71	.82	.76	.71	.79	.74	.69	.76	.71	.67	.73	.69	.66	.64
4.0	.76	.69	.63	.75	.68	.62	.72	.66	.61	.69	.64	.60	.67	.62	.59	.57
5.0	.70	.62	.56	.68	.61	.55	.66	.59	.54	.64	.58	.54	.62	.57	.53	.51
6.0	.64	.56	.50	.63	.55	.50	.61	.54	.49	.59	.53	.48	.57	.52	.48	.46
7.0	.59	.51	.45	.58	.50	.45	.56	.49	.45	.54	.48	.44	.53	.48	.44	.42
8.0	.54	.47	.41	.53	.46	.41	.52	.45	.41	.50	.45	.40	.49	.44	.40	.38
9.0	.50	.43	.38	.50	.43	.38	.48	.42	.38	.47	.41	.37	.46	.41	.37	.35
10.0	.47	.40	.35	.46	.40	.35	.45	.39	.35	.44	.38	.34	.43	.38	.34	.32

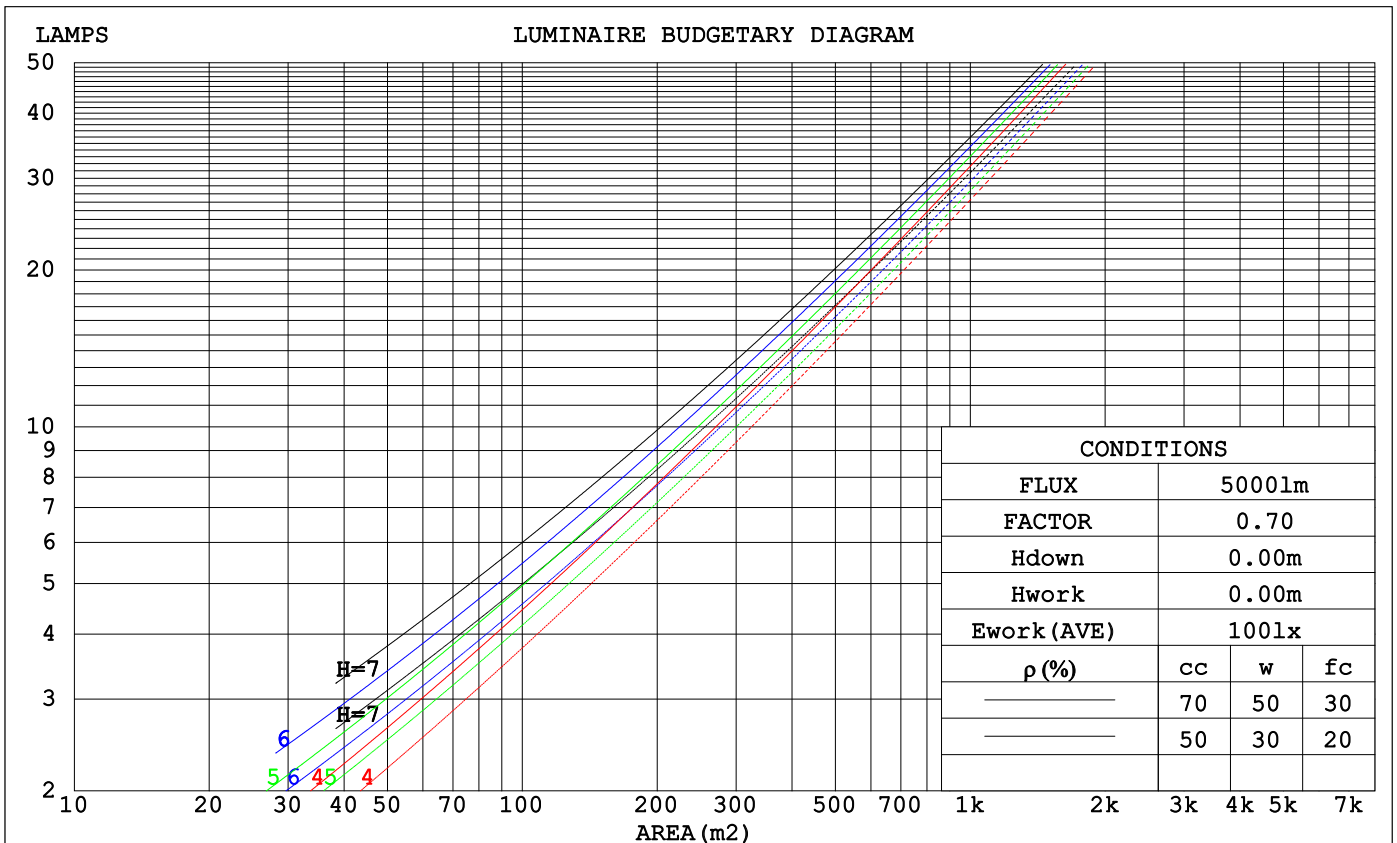

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

WEC AND CCEC

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.276	.157	.050	.268	.153	.048	.252	.145	.046	.239	.138	.044	.226	.131	.042	
2.0	.253	.139	.043	.246	.135	.042	.233	.129	.040	.220	.124	.039	.209	.118	.037	
3.0	.233	.124	.037	.227	.122	.037	.215	.117	.035	.205	.112	.034	.195	.108	.033	
4.0	.216	.112	.033	.211	.110	.033	.200	.106	.032	.191	.102	.031	.182	.099	.030	
5.0	.201	.102	.030	.196	.101	.029	.187	.097	.029	.178	.094	.028	.170	.091	.027	
6.0	.188	.094	.027	.183	.093	.027	.175	.090	.026	.167	.087	.026	.160	.084	.025	
7.0	.176	.087	.025	.172	.086	.024	.164	.083	.024	.157	.081	.023	.151	.078	.023	
8.0	.165	.081	.023	.162	.080	.023	.155	.077	.022	.149	.075	.022	.143	.073	.021	
9.0	.156	.075	.021	.153	.074	.021	.147	.072	.021	.141	.071	.020	.135	.069	.020	
10.0	.147	.071	.020	.144	.070	.019	.139	.068	.019	.134	.066	.019	.129	.065	.019	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.218	.218	.218	.186	.186	.186	.127	.127	.127	.073	.073	.073	.023	.023	.023	
1.0	.205	.184	.164	.176	.158	.141	.120	.108	.098	.069	.063	.057	.022	.020	.018	
2.0	.194	.160	.130	.167	.137	.112	.114	.095	.078	.066	.055	.046	.021	.018	.015	
3.0	.185	.142	.107	.159	.122	.093	.109	.085	.065	.063	.050	.038	.020	.016	.013	
4.0	.176	.128	.091	.151	.111	.079	.104	.077	.056	.060	.045	.033	.019	.015	.011	
5.0	.169	.117	.079	.145	.101	.069	.100	.071	.049	.058	.042	.029	.019	.014	.010	
6.0	.161	.109	.071	.139	.094	.062	.096	.066	.044	.055	.039	.026	.018	.013	.009	
7.0	.155	.102	.064	.133	.088	.056	.092	.062	.040	.053	.036	.024	.017	.012	.008	
8.0	.149	.096	.059	.128	.083	.052	.088	.058	.037	.051	.034	.022	.017	.011	.007	
9.0	.143	.091	.055	.123	.079	.048	.085	.055	.034	.050	.033	.020	.016	.011	.007	
10.0	.138	.086	.052	.119	.075	.046	.082	.053	.032	.048	.031	.019	.016	.010	.006	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	22.1	23.4	22.4	23.6	23.9	22.2	23.5	22.5	23.7	24.0
3H	23.1	24.3	23.5	24.6	24.9	23.3	24.5	23.6	24.8	25.1
4H	23.7	24.8	24.0	25.1	25.4	23.9	25.0	24.3	25.3	25.7
6H	24.3	25.3	24.7	25.7	26.0	24.6	25.6	25.0	26.0	26.3
8H	24.6	25.7	25.0	26.0	26.3	25.0	26.0	25.4	26.3	26.7
12H	25.1	26.0	25.5	26.4	26.8	25.4	26.4	25.8	26.8	27.1
4H 2H	22.5	23.6	22.8	23.9	24.2	22.6	23.7	22.9	24.0	24.3
3H	23.8	24.7	24.1	25.1	25.4	23.9	24.9	24.3	25.2	25.6
4H	24.5	25.4	24.9	25.7	26.1	24.7	25.6	25.1	26.0	26.4
6H	25.3	26.1	25.8	26.5	26.9	25.6	26.4	26.0	26.8	27.2
8H	25.8	26.5	26.2	26.9	27.4	26.1	26.8	26.6	27.3	27.7
12H	26.3	27.0	26.8	27.4	27.9	26.7	27.4	27.2	27.8	28.3
8H 4H	24.8	25.5	25.3	26.0	26.4	25.0	25.7	25.5	26.2	26.6
6H	25.9	26.5	26.4	26.9	27.4	26.1	26.7	26.6	27.2	27.7
8H	26.5	27.0	27.0	27.5	28.1	26.8	27.3	27.3	27.8	28.4
12H	27.3	27.7	27.8	28.2	28.8	27.6	28.1	28.1	28.6	29.1
12H 4H	24.9	25.5	25.3	26.0	26.5	25.0	25.7	25.5	26.2	26.6
6H	26.0	26.6	26.5	27.1	27.6	26.3	26.8	26.8	27.3	27.8
8H	26.7	27.2	27.3	27.7	28.3	27.0	27.5	27.6	28.0	28.6
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.3 / - 0.3					+ 0.2 / - 0.3				
1.5H	+ 0.1 / - 0.2					+ 0.1 / - 0.2				
2.0H	+ 0.3 / - 0.3					+ 0.3 / - 0.3				

CIE Pub.117, 684.6 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -1.3)
 Area: 0.0063 m2

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	66	57	51	66	56	51	65	56	50	45
0.80	76	66	60	75	65	59	73	65	59	53
1.00	83	73	67	81	73	67	79	73	66	60
1.25	89	80	74	87	79	73	84	77	72	66
1.50	93	84	78	91	83	78	88	81	77	70
2.00	98	91	85	96	89	84	93	87	83	75
2.50	101	94	89	99	93	88	95	90	86	78
3.00	104	98	93	102	96	92	97	93	89	81
4.00	107	102	98	105	100	96	100	96	93	84
5.00	109	105	101	107	103	99	102	99	96	86
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended				SHRNOM = 1.25			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

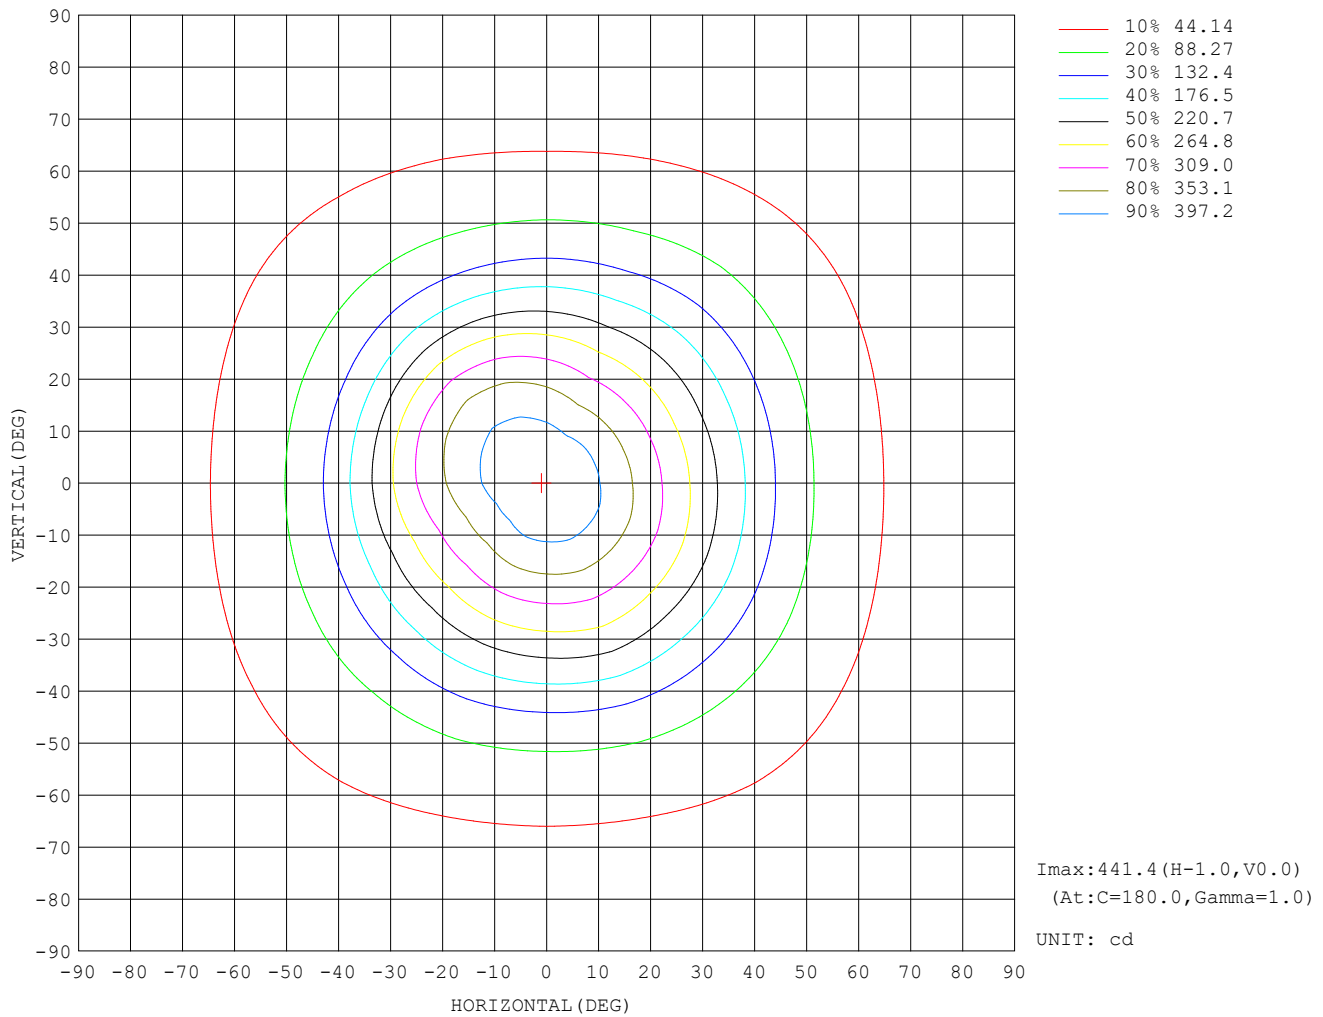

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

AAI Figure

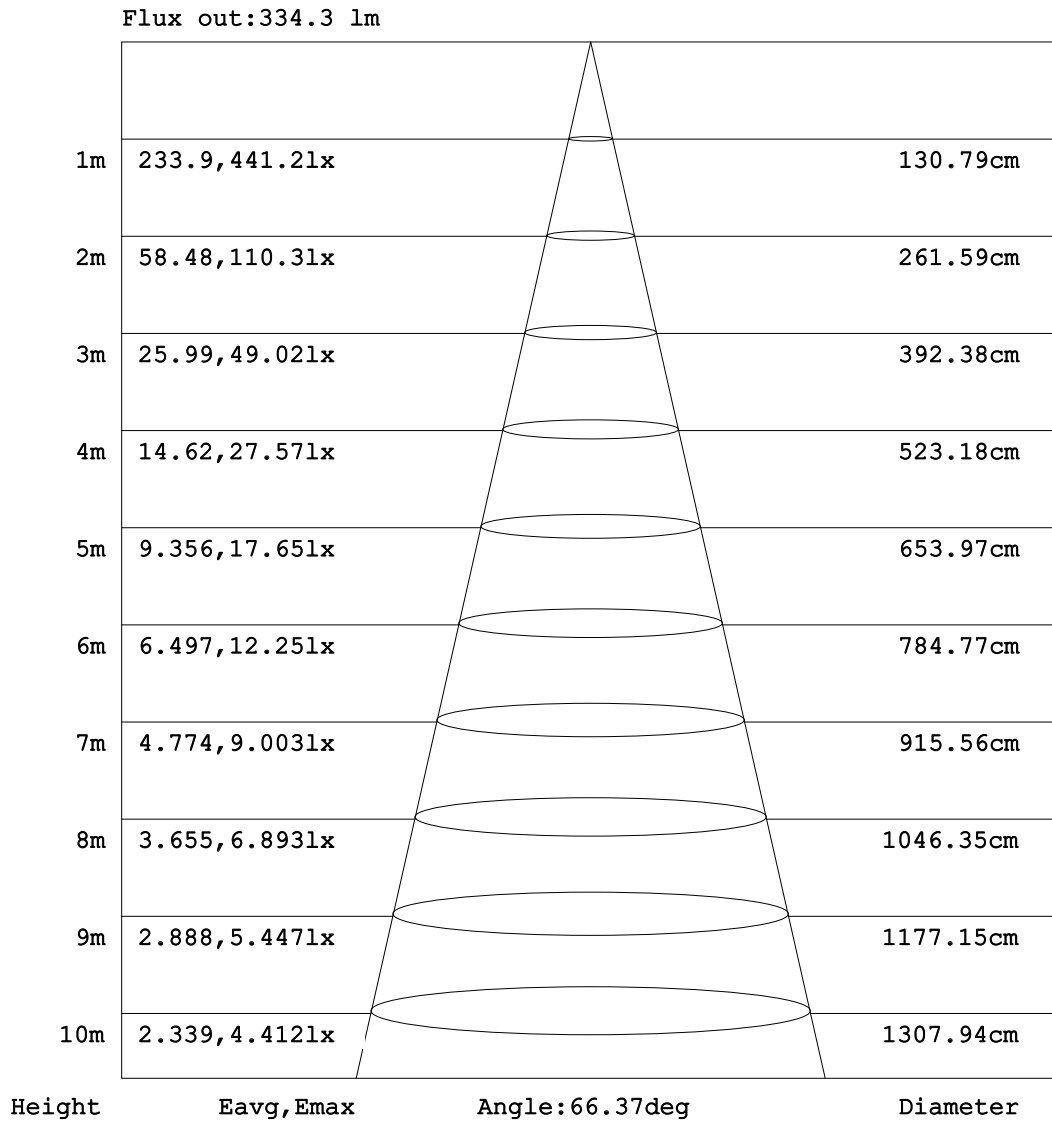


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

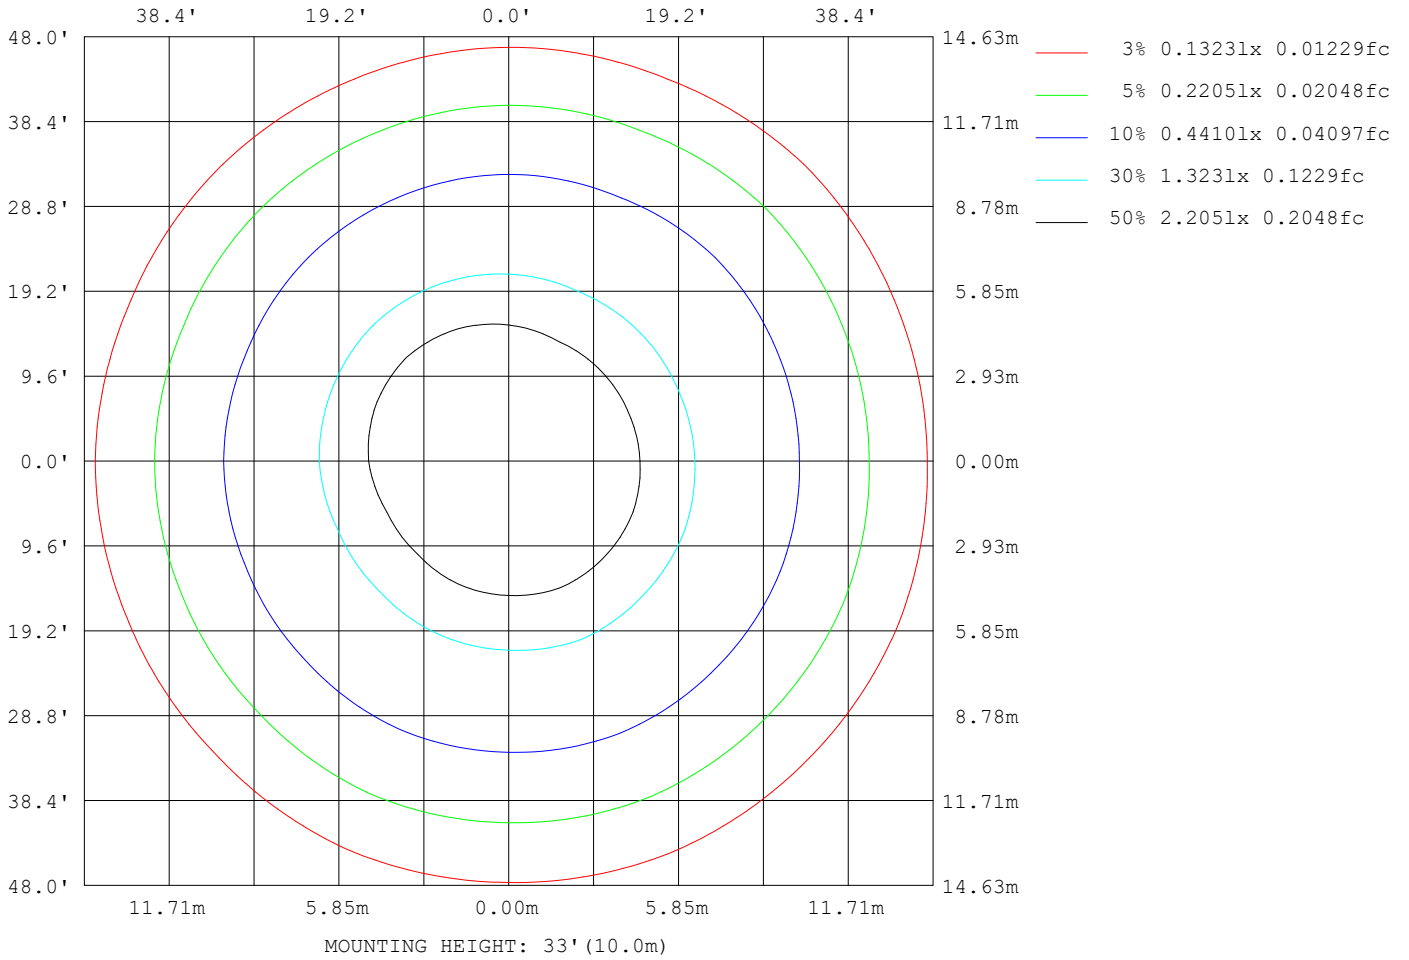

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:220.06V I:0.0543A P:7.2396W PF:0.6061 Freq:50.00Hz Lamp Flux:684.603x1 lm		
NAME: 4" Globe	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	16386
L_0~180 (75) av	17165
L_0~180 (85) av	32364
L_90~270 (65) av	16500
L_90~270 (75) av	17158
L_90~270 (85) av	31729
L_45 (65) av	16477
L_45 (75) av	17182
L_45 (85) av	32052

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

Planar Illuminance Curve

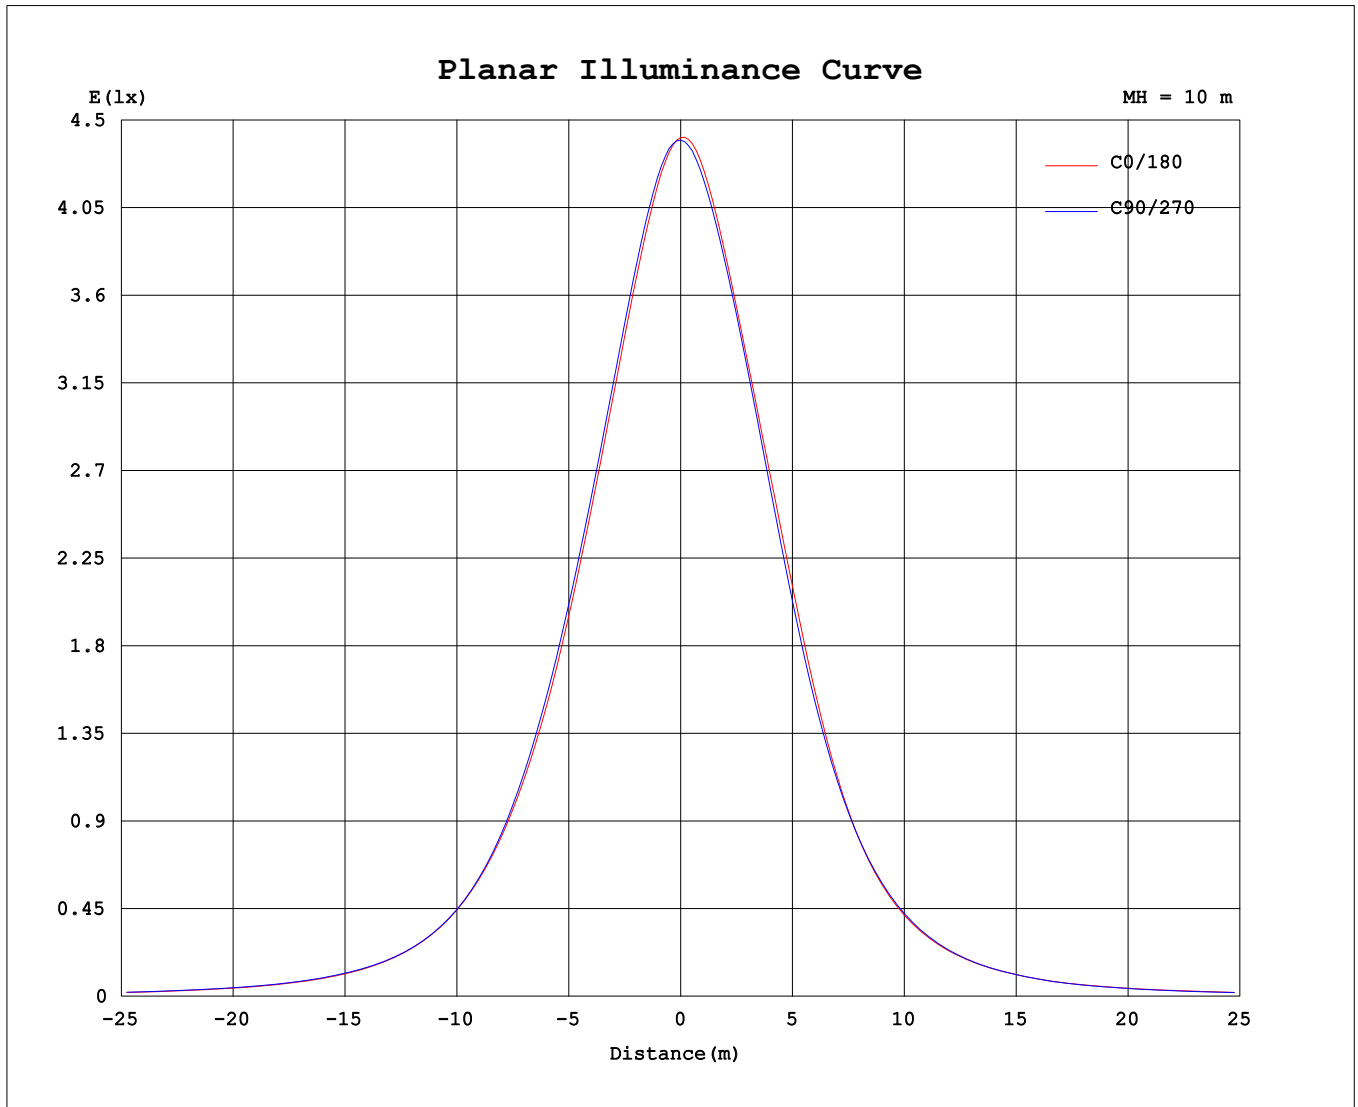

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C (DEG) \ γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	441	441	440	440	440	439	439	438	441	441	440	440	440	439	439	438			
5	427	429	430	432	431	431	426	427	435	435	435	432	430	425	427	426			
10	399	404	406	408	405	404	398	400	412	415	418	414	406	396	397	397			
15	364	370	373	375	371	369	362	366	382	390	396	391	377	362	361	361			
20	326	334	336	339	334	331	324	329	348	360	367	359	341	323	322	322			
25	286	294	297	300	294	290	284	288	309	321	326	315	298	282	281	281			
30	244	252	254	260	252	248	240	242	259	267	271	262	250	239	239	239			
35	203	209	210	216	208	203	195	195	205	207	210	207	202	196	198	198			
40	162	167	167	170	165	161	153	152	156	155	159	158	157	155	159	159			
45	126	129	128	130	126	124	118	116	118	116	119	119	120	120	124	124			
50	95.4	97.9	97.8	98.7	96.2	95.2	90.3	88.9	89.7	88.1	89.6	89.9	91.3	91.2	95.2	95.0			
55	72.6	74.9	75.0	75.8	74.2	73.8	70.2	69.2	69.6	68.0	68.8	68.8	69.8	69.7	72.6	72.2			
60	56.0	56.7	58.4	58.6	58.2	56.9	55.8	53.9	53.9	53.7	52.8	53.5	53.0	53.9	54.5	55.4			
65	43.8	44.4	45.9	45.7	46.2	45.5	44.9	43.6	43.5	43.1	42.1	42.3	41.6	42.2	42.6	43.4			
70	34.6	35.1	36.4	36.4	37.1	36.7	36.5	35.5	35.4	34.9	33.9	33.7	33.0	33.5	33.6	34.2			
75	27.1	27.8	28.6	29.0	29.6	29.7	29.5	29.0	28.8	28.0	27.3	26.7	26.3	26.3	26.6	26.9			
80	21.4	22.0	22.7	23.1	23.6	23.9	23.8	23.5	23.4	22.6	21.9	21.2	20.8	20.7	21.0	21.2			
85	16.8	17.3	17.8	18.2	18.7	19.0	19.0	18.8	18.7	18.0	17.3	16.6	16.2	16.1	16.3	16.6			
90	12.9	13.2	13.5	13.9	14.4	14.7	14.6	14.7	14.8	14.0	13.1	12.6	12.2	12.1	12.2	12.6			
95	9.76	10.0	10.1	10.5	10.9	11.2	11.1	11.3	11.4	10.8	9.88	9.35	9.02	8.89	9.01	9.43			
100	7.21	7.41	7.36	7.69	8.02	8.20	8.19	8.41	8.53	8.01	7.19	6.72	6.45	6.34	6.43	6.88			
105	5.23	4.54	4.64	5.39	5.65	5.78	5.62	4.33	6.18	4.47	4.73	4.64	4.41	4.33	4.26	3.95			
110	3.78	3.58	1.62	3.55	1.47	3.86	2.54	3.18	4.37	3.39	2.04	3.08	1.12	2.76	2.01	2.69			
115	2.80	2.64	0.75	1.87	0.74	2.18	0.74	2.29	3.07	2.44	0.74	1.84	0.71	1.68	0.70	2.11			
120	2.27	2.14	0.94	0.90	0.87	0.87	0.89	1.83	2.26	1.90	0.91	0.92	0.85	0.95	0.84	1.76			
125	2.06	1.97	1.20	1.08	1.06	1.05	1.11	1.73	1.92	1.72	1.14	1.04	1.02	1.00	1.04	1.66			
130	2.10	2.02	1.49	1.29	1.28	1.25	1.37	1.92	1.99	1.82	1.40	1.24	1.20	1.19	1.30	1.73			
135	2.22	2.14	1.79	1.53	1.49	1.48	1.66	2.08	2.13	1.98	1.66	1.43	1.40	1.38	1.53	1.87			
140	2.35	2.27	2.02	1.73	1.71	1.72	1.95	2.22	2.24	2.10	1.83	1.63	1.61	1.59	1.73	2.01			
145	2.46	2.39	2.18	1.95	1.93	1.96	2.15	2.35	2.35	2.22	1.99	1.83	1.82	1.78	1.91	2.15			
150	2.55	2.49	2.30	2.15	2.13	2.16	2.31	2.45	2.43	2.33	2.15	2.02	2.03	2.00	2.09	2.29			
155	2.62	2.57	2.43	2.32	2.32	2.34	2.43	2.54	2.53	2.43	2.30	2.20	2.20	2.17	2.26	2.41			
160	2.68	2.64	2.54	2.47	2.47	2.49	2.54	2.61	2.63	2.54	2.43	2.37	2.37	2.35	2.41	2.52			
165	2.73	2.71	2.64	2.61	2.61	2.62	2.64	2.68	2.71	2.63	2.57	2.53	2.53	2.52	2.51	2.62			
170	2.81	2.78	2.74	2.73	2.72	2.72	2.71	2.74	2.80	2.72	2.67	2.66	2.66	2.66	2.65	2.70			
175	2.89	2.84	2.82	2.80	2.79	2.78	2.78	2.79	2.87	2.80	2.79	2.77	2.76	2.75	2.75	2.77			
180	2.92	2.85	2.84	2.82	2.80	2.81	2.80	2.81	2.92	2.85	2.84	2.82	2.81	2.80	2.81	2.81			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2026-03-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks: